


## TYPICAL “NON- PENETRATING” ROOF MOUNT CONFIGURATION



### Power Requirements:

120v 10 amp: Installation will have EMT conduit supported on sleepers from power source to the camera equipment.

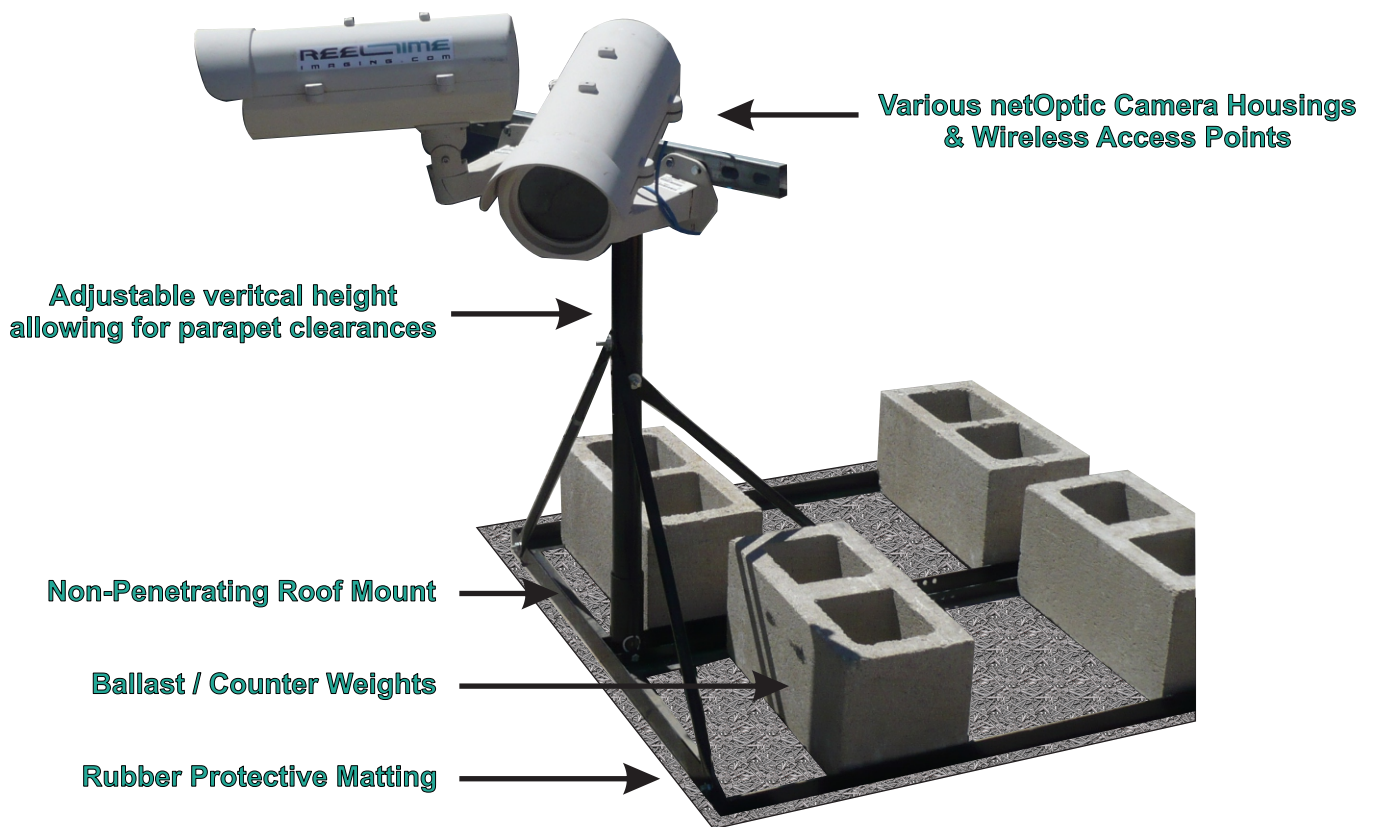